







EC\*-S\*F" type glands, used in any orientation, are certified Flameproof Ex db, Increased Safety Ex eb, Restricted Breathing Ex nR and Dust Protected Ex ta. They are suitable for use in Group Mining, Zone 1 and 2 for Gas Groups IIA, IIB and IIC and additionally for use in Zones 20, 21 and 22 for Dusts Groups IIIA, IIIB and IIIC. Commonly referred to as a "Conduit Stopper Box" they are suitable for use with conductors carried in conduit or as a line bushing for terminating flying leads. They provide a compound barrier Ex db & IP seal on the cable inner cores, eliminating damage to cables that exhibit "cold flow" characteristics. The unique features include, Peppers T1000 or T2000 compound that enables a quick and easy installation. An innovative barrier chamber that allows for a full inspection of the compound fill. The gland maintains IP66, IP68 to 100 metres and IP 69. Is deluge proof without the use of an additional seal or deluge boot. It is supplied with an IP O-ring seal as standard on metric entry threads. The gland is supplied with a female conduit connection thread.

## COMPLIANCE STANDARDS:

UKEX

EN 60079-0, EN 60079-1, EN 60079-7, EN 60079-15, EN 60079-31 IEC 60079-0, IEC 60079-1, IEC 60079-7, IEC 60079-15, IEC 60079-31 & IEC 60529

II 3G Ex nR IIC Gc

ATEX I M2 II 1D 2G Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex ta IIIC Da

II 3G Ex nR IIC Gc

Ex db | Mb / Ex db | IC Gb / Ex eb | Mb / Ex eb | IC Gb / Ex nR | IC Gc / Ex ta | IIC Da **IECE**x

PB Ex db I Mb X / 1Ex db IIC Gb X / PB Ex eb I Mb x / 1Ex eb IIC Gb X / 2Ex nR IIC Gc X EAC

LM2 II 1D 2G Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex ta IIIC Da

CCC - China Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da CCoE - India Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da ECAS-Ex - U.A.E

ABS

LLOYD'S Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da

DNV Ex db I Mb / Ex db IIC Gb / Ex eb I Mb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da

UKEX CML 21UKEX1036X & CML 21UKEX4037X

ATEX CML 19ATEX1113X & CML 19ATEX4114X


IECEx IECEx CML 19.0035X RU C-GB.AЖ58.B.05106/24 EAC

CCC - China 2022312313000471

CCoE - India PESO P494321/17 & P494321/20

ECAS-Ex - U.A.E 25-06-153223/E25-06-159811/NB0007

ABS 25-0158110-PDA LLOYD'S LR25189453TA DNV TAF00004XK

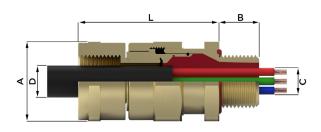

**EXAMPLE PART NUMBERING** EC2-SBF20/NP/M20/050NP1

Eclipse style barrier gland for use with Peppers T1000 or T2000 compound Peppers T1000 (1) - Peppers T2000 (2) Gland featuring a compound (Barrier) Inner Seal for use with conduit Brass (B) / Stainless Steel (S) Back End Configuration: Female (F) K-V-H Locknut & Nylon (K), Fibre (V) or PTFE (H) IP Washer Including Earth Tag Including Serrated Washer Quantity per kit Gland shell size NP Nickel Plated M20 x 1.5 Male Entry Thread 1/2"NPT Internal Female Connection Thread

LOCKNUT (L)	Brass (ACBLN) / Stainless Steel (ACSLN)
EARTH TAG (T)	Brass (ACBET) / Stainless Steel (ACSET)
IP WASHERS	Nylon (N) / Fibre (J) / PTFE (Z)
SERRATED WASHERS	Stainless Steel (S)

IP RATING:	IP66 & IP68 (100 metres - 7 days) & IP69						
OPERATING TEMP:	T1000: -60°C to +135°C						
	T2000: -60°C to +120°C						
MATERIALS:	Brass or Stainless Steel						
PLATING:	Electroless Nickel						
COMPOUND:	Peppers T-1000 Compound / Peppers T-2000 Compound						

CERTIFICATION No:

Gland size	Entry Thread Size		Metric Thread	Female Entry Threads		Gland Sealing Range - Cable Sheath & Cores								
						Max Number	Max Number	Max Ø Over	Min Inner	Max Outer	Nominal Protrusion	Dimensions/Weight (Metric)		
	Metric	NPT	Length [B]	Metric	NPT	of Cores [C] [T1000]	of Cores [C] [T2000]	Cores [C]	Sheath [T2000]	Sheath [D]	Length [L]	Across Flats [A]	Across Corners	Weight (Kgs)
16S	M16 x 1.5	3/8"	16	M16	3/8"	12	12	8.9	4.0	10.0	54	25.4	28.0	0.161
20	M20 x 1.5	1/2" or 3/4"	16	M20	1/2" or 3/4"	40	20	12.5	4.0	14.0	55	30.0	33.0	0.217
25	M25 x 1.5	3/4" or 1"	16	M25	3/4" or 1"	60	30	16.5	8.0	18.5	60	37.6	41.4	0.341
32	M32 x 1.5	1" or 1 1/4"	16	M32	1" or 1 ¼"	80	50	23.5	14.0	26.3	61	46.0	50.6	0.516
40	M40 x 1.5	1 ¼" or 1 ½"	16	M40	1 1/4" or 1 1/2"	130	65	28.8	16.0	32.2	61	55.0	60.5	0.674
50S	M50 x 1.5	1 ½" or 2"	16	M50	1½" or 2"	200	100	34.2	20.0	38.2	65	65.0	71.5	0.781
50	M50 x 1.5	2"	16	M50	2"	400	100	39.4	20.0	44.1	65	65.0	71.5	0.781
63S	M63 x 1.5	2" or 2 ½"	19	M63	2" or 2 ½"	400	130	44.8	30.0	50.1	74	80.0	88.0	1.247
63	M63 x 1.5	2 ½"	19	M63	2 ½"	425	130	50.0	30.0	56.0	74	80.0	88.0	1.247
75S*	M75 x 1.5	2 ½" or 3"	19	M75	2 ½" or 3"	425	-	55.4	-	62.0	76	90.0	99.0	1.339
75*	M75 x 1.5	3"	19	M75	3"	425	-	60.8	-	68.0	76	90.0	99.0	1.339
80*	M80 x 2.0	3" or 3 ½"	25	M80	3" or 3 ½"	425	-	64.4	-	72.0	92	104.7	115.2	3.061
85*	M85 x 2.0	3" or 3 ½"	25	M85	3" or 3 ½"	425	-	69.8	-	78.0	92	104.7	115.2	2.512
90*	M90 x 2.0	3 ½" or 4"	25	M90	3 ½" or 4"	425	-	75.1	-	84.0	89	114.3	125.7	3.143
100*	M100 x 2.0	3 ½" or 4"	25	M100	3 ½" or 4"	425	-	80.5	-	90.0	90	114.3	125.7	2.603

- · Gland size does not necessarily equate to the entry thread size.
- The IP O-ring seal is only available on metric entry threads. IP washers can be supplied for tapered entry threads
- Dimensions (A) & (B) may differ for glands with non metric entry threads. Please refer to our "Thread Reference Tables" for specific dimensions.
- · Assembly instructions must be read prior to installation and adhered to in full.
- · Peppers supplies cable glands with parallel entry threads that conform to the flameproof threaded joint requirements of IEC/EN 60079-1 and other equivalent standards. We usually incorporate a thread run out according to general machining techniques and parts will not have a full form thread for the entire length. Peppers Cable Glands Limited will not be held
- responsible for clients' installations where this has not been taken into account
- · When selecting IP Washer material for use with glands, please be aware of the accessories temperature range to ensure they are suitable for the intended installation.
- The gland is supplied with the correct amount of compound, gloves and instructions to allow one complete termination
- · Where approval in addition to UKEX, ATEX and IECEx is required, this must be clearly requested at time of enquiry / order.
- \* Size 75S and above only available with T1000 Compound.