

D*U***F & E*U***F* Type Cable Glands for Armoured Cable – ASSEMBLY INSTRUCTIONS

Brief Description


Peppers E*U***F* type cable glands are for outdoor use in the appropriate Hazardous Areas with armoured cable. They give environmental protection to IP66, IP67 and IP68 (50 metres for 7 days). The type IE option has an earth stud on the entry body. D*U***F type glands are for indoor use and offer the same level of environmental protection. A termination suitable for EMC protection can be made using armoured cables with these glands. Clamp options allow wire armour, braid and steel tape armours. A variant giving electrical continuity to a lead sheath cable is available.

Warning

Please read these instructions carefully. These products should not be used in applications except as detailed here or in our datasheets, unless confirmed in writing by Peppers. Peppers take no responsibility for any damage, injury or other consequential loss caused where products are not installed or used according to these instructions. This leaflet is not intended to advise on the selection of product. Further guidance can be found in the standards listed overleaf or the prevailing code of practice.

STEP-BY-STEP INSTRUCTIONS (Note: No Back Nut & Outer Sheath Seal in D*U***F Glands)


SPLIT GLAND

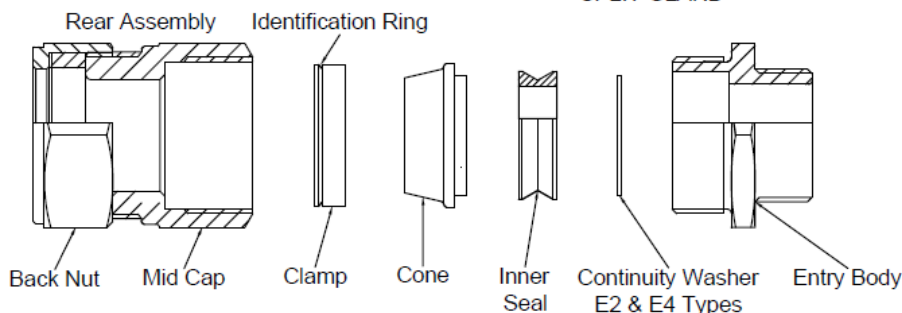


Note:

1. For wire armour fit clamp with Identification Ring to rear (as illustrated).
2. For woven steel wire, braid and steel tape fit clamp with Identification Ring to front.


CABLE PREPARATION

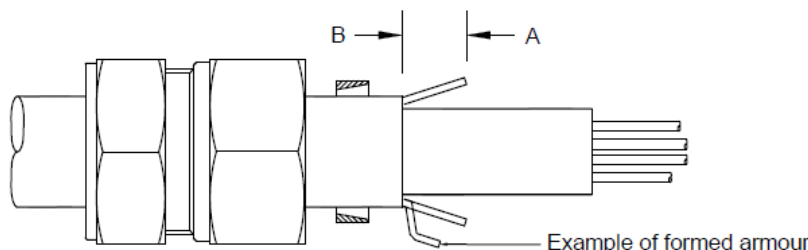

ARMOUR CLAMPING

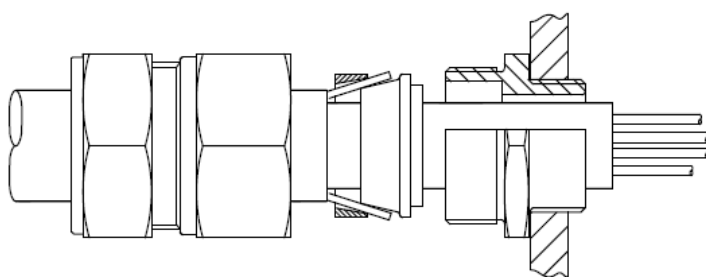

COMPLETED INSTALLATION

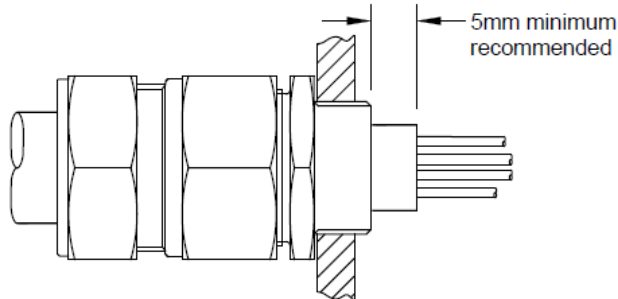

STEP-BY-STEP FITTING INSTRUCTIONS

1. Split gland as shown.
2. Remove the Inner Seal. This must be removed to effectively clamp armour. For E2U***F* & E4U***F* types: - remove Continuity Washer.
3. Fit Entry Body, allowing for any installation accessories, and fully engage the thread into the equipment. Hand-tighten, then suitably secure with a wrench. Further guidance can be found in Peppers document CT0030 which can be found on our website.
4. Slide Rear Assembly (and shroud if required) onto cable as shown.
5. Prepare cable as shown in diagram.
 - A. Strip the outer sheath and armour to suit the installation. For lead sheathed cable the lead sheath must pass through the Continuity Washer when installation is complete.
 - B. Expose armour approx. 20mm long and slide the Clamp over the exposed armour. Slide cone on to inner sheath and spread armour over the cone. Where sheath sizes are near minimum, form armour to facilitate clamping as shown. Ensure the Clamp is in the correct orientation for armour type. The clamp should be positioned so that the identification ring is away from the cone for wire armour and towards the cone for woven wire, braid or tape.
6. Insert cable through Entry Body. Do not re-fit Inner Seal or Continuity Washer. Push cable forward to maintain armour contact. Ensure the armour is in contact with the face of the Cone.
7. Support the cable to prevent it from twisting. Hand tighten Mid Cap to Entry Body to lock onto armour. When tight, further tighten Mid Cap 1 full turn with wrench. Cable with maximum diameter wire armour may require an additional ½ to 1 turn.
8. Loosen off Mid Cap to visually check armour is securely locked. If armour has not clamped repeat the clamping process.
9. Pull out cable from Entry Body. Re-fit the inner seal (and Continuity Washer on E2*U*8*F* & E4*U*8*F* Types). Re-insert cable through the seal, (and Continuity Washer if fitted) and Entry Body. For lead sheath cable the Continuity Washer must be in contact with the lead sheath & must be in front of the Inner Seal.
10. Re-tighten the Mid Cap to the Entry Body. Ensure the Inner Seal makes full contact with the cable sheath and then tighten the Mid Cap by the additional turns detailed in Table 1
11. Hold Mid Cap with wrench and tighten Back Nut onto cable. Ensure the Back Seal makes full contact with cable outer sheath and then tighten the Back Nut by the additional turns detailed in Table 1. If fitted, pull shroud over gland assembly.
12. (E*U**IEF* / D*U**IEF* options) For Integral Earth cable glands, connect the earth cable to the Earth Stud.

Table 1 - Installation Data, Cable Sizes and Armour Acceptance (mm)

Gland Size	Mid Cap Turns – Step 10	Back Nut Turns – Step 11	Inner Sheath		Outer Sheath		Reduced Bore		Armour Acceptance Ranges			
			Min.	Max.	Min.	Max.	Min.	Max.	Wire **		Braid & Tape **	
16	1	1	3.5	8.4	8.4	13.5	4.9	10.0	Min.	Max.	Min.	Max.
20S	1	1	8.0	11.7	11.5	16.0	9.4	12.5	0.8	1.25	0.2	0.8
20	1	1	6.7*	14.0	15.5	21.1	12.0	17.6	0.8	1.25	0.2	0.8

D*U***F & E*U***F* Type Cable Glands – ASSEMBLY INSTRUCTIONS

Gland Size	Mid Cap Turns – Step 10	Back Nut Turns – Step 11	Inner Sheath		Outer Sheath		Reduced Bore		Armour Acceptance Ranges			
			Min.	Max.	Min.	Max.	Min.	Max.	Wire **		Braid & Tape **	
25	1	1	13.0	20.0	20.3	27.4	16.8	23.9	1.25	1.6	0.2	0.8
32	1	2	19.0	26.3	26.7	34.0	23.2	30.5	1.6	2.0	0.3	1.2
40	1	1	25.0	32.2	33.0	40.6	28.6	36.2	1.6	2.0	0.3	1.2
50S	1	1	31.5	38.2	39.4	46.7	34.8	42.4	2.0	2.5	0.3	1.6
50H	1	2	31.5	38.2	45.7	53.2	34.8	42.4	2.0	2.5	0.3	1.6
50	1	2	36.5	44.1	45.7	53.2	41.1	48.5	2.0	2.5	0.3	1.6
63S	1	1	42.5	50.1	52.1	59.5	47.5	54.8	2.0	2.5	0.3	1.6
63H	1	1	42.5	50.1	58.4	65.8	47.5	54.8	2.0	2.5	0.3	1.6
63	1	1	49.5	56.0	58.4	65.8	53.8	61.2	2.0	2.5	0.3	1.6
75S	1 ¼	1	54.5	62.0	64.8	72.2	60.2	68.0	2.0	2.5	0.5	1.6
75H	1 ¼	1	54.5	62.0	71.1	78.0	66.5	73.4	2.0	2.5	0.5	1.6
75	1 ¼	1	60.5	68.0	71.1	78.0	66.5	73.4	2.0	2.5	0.5	1.6
80	1 ¼	1	62.2	72.0	77.0	84.0	71.9	79.4	3.15	4.0	0.5	1.6
80H	1 ¼	1	62.2	72.0	79.6	90.0	75.0	85.4	3.15	4.0	0.5	1.6
85	1 ¼	1	69.0	78.0	79.6	90.0	75.0	85.4	3.15	4.0	0.5	1.6
90	1	3	74.0	84.0	88.0	96.0	82.0	91.4	3.15	4.0	0.5	1.6
90H	1	1	74.0	84.0	92.0	102.0	87.4	97.4	3.15	4.0	0.5	1.6
100	1	1	82.0	90.0	92.0	102.0	87.4	97.4	3.15	4.0	0.5	1.6

* Type 3 & 4 (silicone) seals only to 9.3 mm diameter. ** Minimum stated ranges for Braid and Tape are for double layer braid and single layer tape.

Approvals and Certification

Approval	Certificate Number	Protection Concept / Type
ATEX (2014/34/EU)	CML 19ATEX1106X / CML 21UKEX1035X	Ex II 1D 2G Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIIC Da
UKCA (SI 2016 No. 1107)	CML 19ATEX4109X / CML 21UKEX4043X	Ex II 3G Ex nR IIC Gc
IECEX	IECEX CML 19.0031X	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
CSA	1356011	Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIIC Da Class I Zone 1 AEx eb IIC Gb / Zone 20 AEx ta IIIC Da CL II Gr EFG / CL III Type 4X / IP66 IP68
INMETRO	NCC 13.2186X	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
EAC	ПРОММАШ ТЕСТ RU C-GB.AX58.B.05106	1Ex db IIC Gb X / 1Ex eb IIC Gb X / 2Ex nR IIC Gc X / Ex ta IIIC Da X
CCC	2021312313000406	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da IP66
CCoE (PESO)	P494321/4 & P494321/13	Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIIC Da / Ex nR IIC Gc
ECASEX	25-06-153223/E25-06-159811/NB0007	Ex db IIC Gb / Ex eb IIC Gb / Ex ta IIIC Da / Ex nR IIC Gc
ABS	25-0158110-PDA	Specified ABS Rules – See certificate
Lloyd's Register	LR2124442TA	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da
DNV	TAE00004XK	Ex db IIC Gb / Ex eb IIC Gb / Ex nR IIC Gc / Ex ta IIIC Da

Installation Guidance

Point	Advice
1	BS/EN/IEC 60079-10 BS/EN/IEC 60079-14 National Electrical Code (NEC 500-505) Canadian Electrical Code (CSA C22.1)
2	Installation should only be carried out by a competent electrician, skilled in cable gland and appropriate electrical installations.
3	Comprehensive details of the compliance standards can be found in the product certificates which are available for download from our website.
4	NO INSTALLATION SHOULD BE CARRIED OUT UNDER LIVE CONDITIONS.
5	Threaded entries: the product can be installed directly into threaded entries. Threaded entries should comply with the relevant applicable standards and have a lead-in chamfer to allow for full engagement of the threads. Failure to provide a sufficient lead-in chamfer may lead to ingress sealing issues. For Ex db applications a minimum of 5 fully engaged threads is required.
6	Clearance holes: these shall be no larger than 0.7mm above the nominal diameter of the external entry thread. The product should be secured with a Peppers locknut and then tightened to ensure the cable gland is secure. Where no integral sealing method is provided a Peppers sealing washer should be used to maintain IP ratings. A Peppers serrated washer should be used for additional installation protection. Peppers does not recommend using tapered threads in clearance holes.
7	Ingress protection: to maintain the Ingress Protection rating of the product, the entry hole must be perpendicular to the surface of the enclosure. The surface should be clean, dry and must be sufficiently flat and rigid to support the assembly and make the IP joint. Parallel entry threads will maintain an IP rating of IP64. A Peppers sealing washer should be used to maintain all IP ratings greater than IP64. Whilst Peppers products with tapered threads, when installed into a threaded entry, have been tested to maintain IP66 without any additional sealant, due to the differing gauging tolerances associated with the use of tapered threads it is recommended to use a non-hardening thread sealant if an IP rating higher than IP64 is required. Any thread sealant used should be suitable for use in the hazardous area or location where the equipment is installed, have a suitable temperature range for the temperature at the point of mounting, not contain evaporating solvents and not cause corrosion at the threaded interface when used with dissimilar materials. The product incorporates a thread run out according to general machining techniques and will not have a full form thread for the entire length. Threaded entries should have a suitable lead-in chamfer to ensure a seal is maintained, further guidance can be found on Peppers website. It is the user's/installer's responsibility to ensure that the interface between the enclosure and cable gland is suitably sealed for the required application.
8	Where a bonding connection to earth is required a Peppers earth tag should be used. Peppers earth tags have been independently tested to comply with the Category B values given in IEC 62444. Peppers earth tags should be fitted over the external entry thread from either inside or outside the enclosure. If fitted internally they must be secured with a Peppers locknut and optionally a Peppers serrated washer. Further guidance can be found in Peppers document CT0170 which can be found on our website.
9	Peppers external metric entry threads comply with ISO 965-1 & ISO 965-3 with a 6g tolerance fit. The standard metric thread pitch is 1.5mm for threads up to M75 and 2.0mm for size M80 and above. Alternative thread pitches are available upon request. Peppers external NPT threads comply with ASME B1.20.1 with gauging to clause 8.1. All threads comply with the threaded joint requirements of clause 5.3 from IEC 60079-1. Information on other thread types can be found in the product certificates.
10	Once installed do not dismantle except for routine inspection. An inspection should be conducted as per IEC 60079-17. After inspection the gland should be re-assembled as instructed, ensuring the compression nut, mid cap and back nut are correctly tightened to ensure the cable is secure.
11	If required an anti-seize lubricant may be used to aid assembly and routine inspection, if used care should be taken to ensure no lubricant comes into contact with the cable gland seals as this may impair performance. Any lubricant used should comply with the prevailing code of practice, be suitable for use in the hazardous area or location where the equipment is installed, have a suitable temperature range and not contain evaporating solvents.

Interpretation of Markings

Markings on the gland carry the following meanings, Cable Gland Type & Size E-a-b-c-IE-F-R-ddd-eee-nn

a =	Seal material	1 = Neoprene (black)	2 = Neoprene with Continuity washer	R =	Optional reduced bore outer seal (red silicone)
b =	Armour clamping	3 = Silicone (white)	4 = Silicone with Continuity washer	ddd =	Gland size
c =	Main component material	U = Universal (multi) armour clamping		eee =	Entry thread type and size
IE =	Optional Integral Earth Stud	B = Brass	S = Stainless Steel	nn =	Year of manufacture

Specific Conditions of Use

- E*U***F* & D*U***F glands must not be used in enclosures where the temperature at the point of contact is outside the range of -35°C to +90°C using neoprene seals, or -60°C to +180°C using silicone seals.
- If E*U***F* & D*U***F glands only grip the cable sheath and do not clamp the cable armour or if they are used to terminate unarmoured, braided or screened cables, then they shall only be used for fixed installations, and the cables shall be effectively clamped to prevent pulling or twisting.
- When installed in accordance with these instructions within appropriate equipment, E*U***F* & D*U***F glands are capable of providing an ingress protection of IP66 and IP68 (50 metres - 7 days).
- When used in explosive dust atmospheres and installed in threaded entries without interface O-ring seals, E*U***F* & D*U***F glands shall only be fitted into enclosures that have either:
 - parallel entries that will ensure a minimum of 5 full threads of contact will be maintained, this is in accordance with clause 5.1.2 of IEC 60079-31.
 - tapered entries that will ensure a minimum of 3 ½ full threads of contact will be maintained, this is in accordance with clause 5.1.2 of IEC 60079-31.